



TANK CAN UNROLLED INSIDE TO SHOW TANK INTERIOR WALL

SEE LAYOUT RIGHT FOR TANK FLOOR

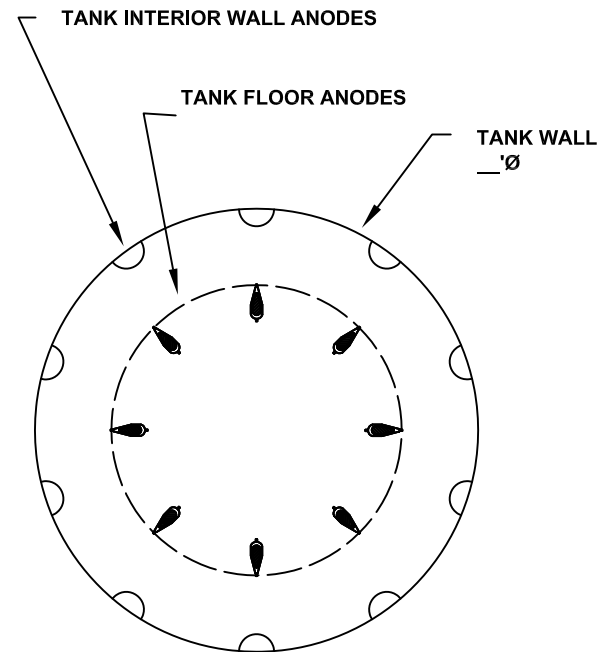

NOTES:

1. INSTALL ANODES ON $\frac{1}{2}$ " BOLTS OR STUDS IN APPROXIMATE LOCATIONS SHOWN, INSIDE TANK ON 11- $\frac{1}{8}$ " VERTICAL CENTERS.
2. AFTER TANK CONSTRUCTION BOLT ANODES IN PLACE USING GALVANIZED HARDWARE WITH LOCK WASHERS IN ORDER TO INSURE ELECTRICAL CONTACT WITH THE TANK SHELL. USE 'OXGUARD' OR OTHER SIMILAR COMPOUND TO INSURE LONG TERM ELECTRICAL CONTACT.
3. THESE ANODES WILL NOT HAVE A COATING, DO NOT COAT THESE ANODES.



| |
|----------------------------------------------------------------------------------|
| Typical Bolted Tank Layout |
| Galvanic Anode Cathodic Protection System |
| MAGGART & ASSOCIATES INC 5002 D North Royal Atlanta Drive TUCKER, GA 30084 |
| Date: April 2018 |